


SINGLE LINE DIAGRAM
SINGLE POLE INSTALLATION
(N.T.S)


SINGLE LINE DIAGRAM MAIN
SWITCHBOARD AND MULTIPLE
POLES INSTALLATION
(N.T.S)

NOTES

1. Minimum of 100mm separation to be maintained between street light conduits and other services.
2. Minimum of 250mm separation to be maintained between Gas Pipes and other services.
3. Additional 100mm street light conduit to be installed where required.
4. Circuit breaker type and rating shall be determined by the designer. Circuit breaker ratings depicted on the drawings are indicative only.
5. Number of circuits as required for project plus 50% spare for each switchboard
6. Fuse rating indicative only.

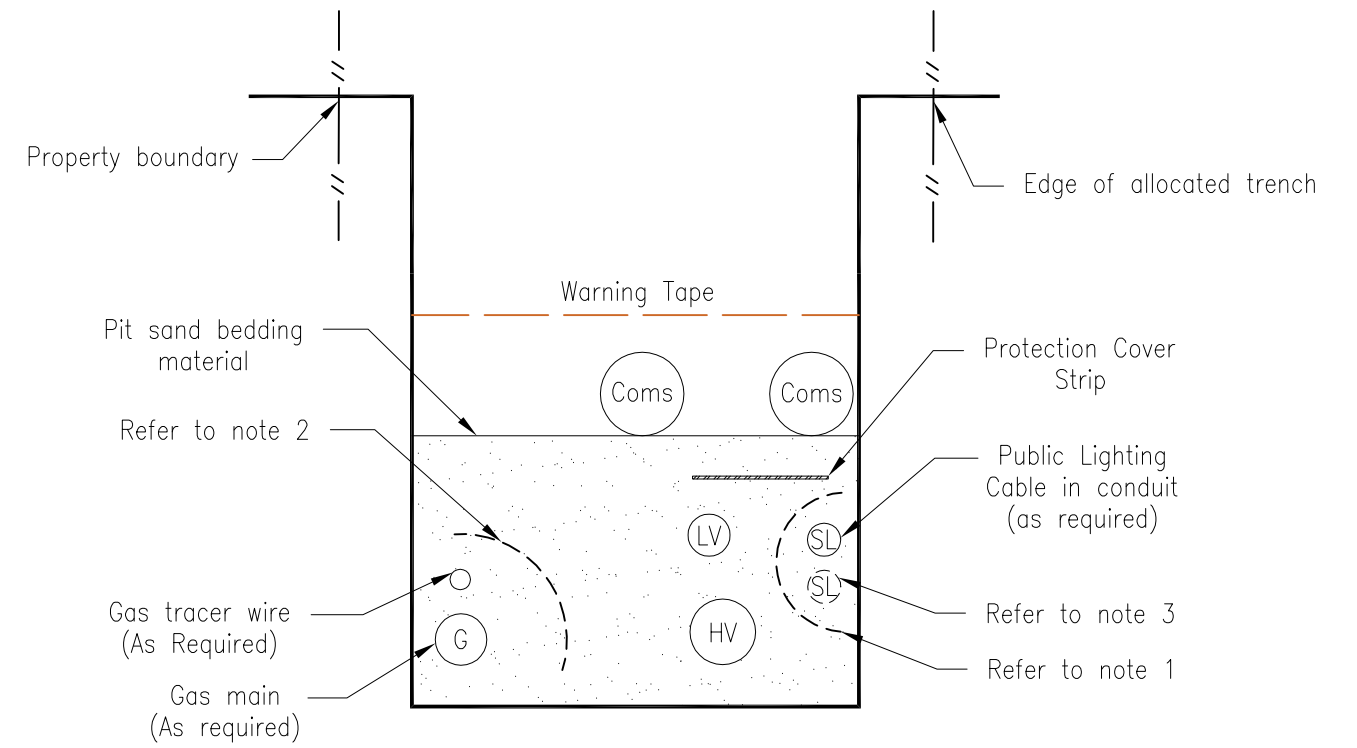

TYPICAL TRENCH CROSS SECTION
(N.T.S)

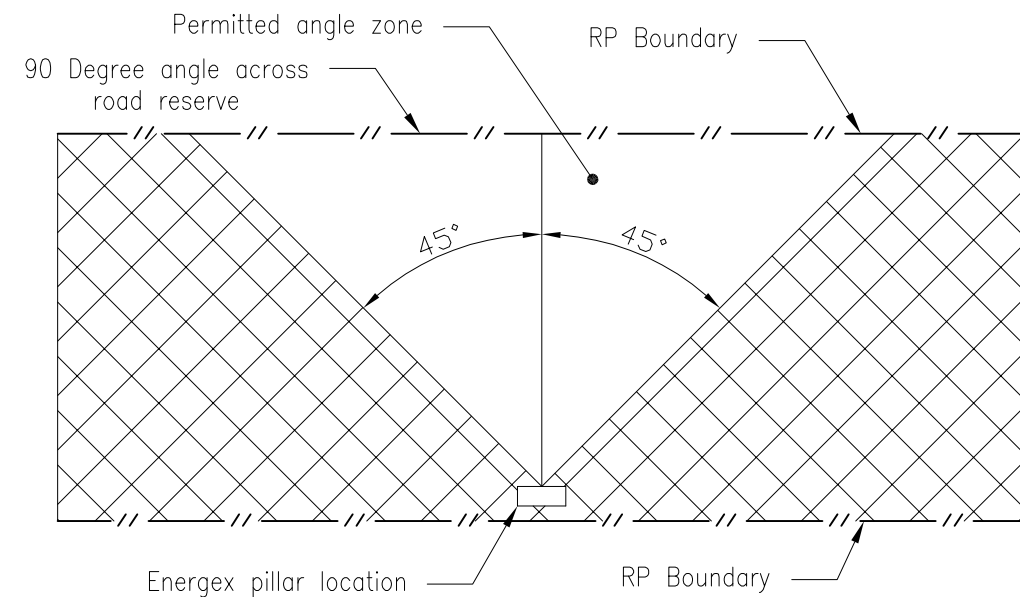

ROAD CROSSING CONDUIT ANGLE LIMITS
(N.T.S)

REVISIONS					
AMENDMENT	INITIALS	DATE	AMENDMENT	INITIALS	DATE
F				L	
E				K	
D				J	
C				I	
B	RPEQ SIGN OFF	TM 16/03/18	H		
A	DRAFT - NOT ISSUED	SGL 25/7/17	G		



IPSWICH CITY COUNCIL
P.O. Box 191 Ipswich QLD 4305 Australia
Telephone: (07) 3810 6666
Website: www.ipswichplanning.com.au

STANDARD DRAWING

RATE 3 PUBLIC LIGHTING
SINGLE LINE DIAGRAM &
CONDUIT INSTALLATION DETAILS

LIGHTING

SL.07

REV: B DRAWER: 100