


Slightly recess plant 25mm below surrounding soil level

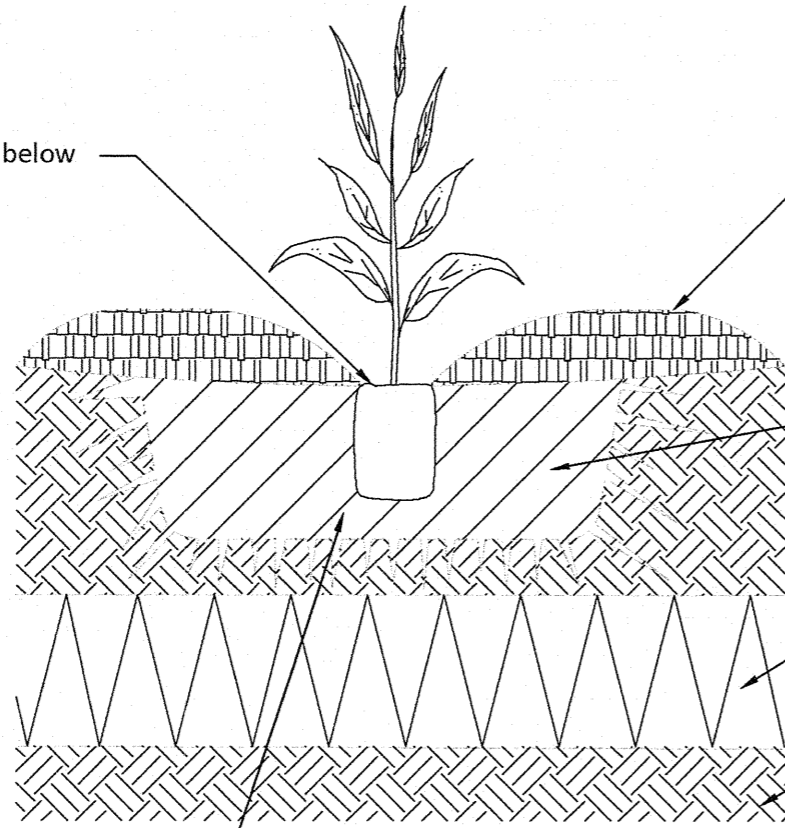

75-100mm min depth of aged organic mulch (HWD chip not accepted). Maintain 50mm separation between mulch and stem. Other mulch types must be approved by ICC. Mulch to be maintained weed free.

If existing soil is of poor quality, provide 50/50 mixed blend of existing soil with imported soil (as per: AS4419-2003) to a min depth of 300mm. Refer Note 3.

Rip subgrade to a min depth of 200mm

Existing subgrade

Planting hole to be 3 times the width and $1\frac{1}{2}$ times the depth of the plant pot size. Scarify walls and base of hole to 100mm

NOTES:

1. Supply and install non petroleum based soil-wetting agent or water crystals in accordance with Manufacturer's instructions.
2. Soil wetting agent with fertiliser additive to be mixed through full depth of existing and imported topsoil.
3. Soil test to be carried out to determine if any amelioration works are necessary to improve the soils condition.
4. For Revegetation and/or Waterway Planting refer to:
Ipswich City Council: Waterway Health Strategy (WHS) 2009
Ipswich City Council: Waterway and Channel Rehabilitation Guidelines 2010
Ipswich City Council: Riparian Corridor Revegetation Guidelines.
5. A protective tree guard/grow tube positioned around each plant may be required in these planting contexts.

REVISIONS

AMENDMENT	INITIALS	DATE	AMENDMENT	INITIALS	DATE
F				L	
E				K	
D				J	
C	Notes Altered			I	
B	Notes Altered			H	
A	ORIGINAL ISSUE			G	



IPSWICH CITY COUNCIL
45 Roderick St
P.O. Box 191
Ipswich QLD 4305
Australia

APPROVED
CHIEF OPERATING OFFICER (WPR)
DATE 29-7-13

STANDARD DRAWING

PLANTING - TUBESTOCK/GROUNDCOVERS/SHRUB IN PLANTING AREA

PARKS

SP.02

REV: C DRAWER: 100